



**National Electric Power Regulatory Authority**  
Islamic Republic of Pakistan

**Registrar**

2nd Floor, OPF Building, G-5/2, Islamabad,  
Ph: 051-9206500, 9207200, Fax: 9210215  
E-mail: registrar@nepra.org.pk

No. NEPRA/R/LAD-30/10898-10900

September 03, 2013

Mr. Abdul Hameed Bhutta  
General Manager HR/Admin  
Ibrahim Fibres Limited  
Ibrahim Centre, 15-Club Road,  
Faisalabad


Subject: **Modification-I in Distribution Licence No. 17/DL/2008 —  
Ibrahim Fibres Limited (IFL)**

Reference: *Your letter No. IFL/NEPRA/1030-01 dated December 14, 2012.*

It is intimated that the Authority has approved "Licensee Proposed Modification" in Distribution Licence No. 17/DL/2008 (issued on July 22, 2008) in respect of Ibrahim Fibres Limited pursuant to Regulation 10(11) of the NEPRA Licensing (Application & Modification Procedure) Regulations, 1999.

2. Enclosed please find herewith Modification-I in the Distribution Licence No. DL/17/2008, as approved by the Authority. Further, the determination of the Authority in the matter is also attached.

**Encl:/As above**



(Syed Safer Hussain)

Copy to:

1. Secretary, Irrigation & Power Department, Government of Punjab, Near Old Anarkali, Lahore
1. Chief Executive Officer, Faisalabad Electric Supply Company Limited, Abdullahpur, Canal Bank Road, Faisalabad

**National Electric Power Regulatory Authority  
(NEPRA)  
Islamabad – Pakistan**


**DISTRIBUTION LICENCE**

**17/DL/2008**

In exercise of the Powers conferred upon the National Electric Power Regulatory Authority (NEPRA) under Section-26 of the Regulation of Generation, Transmission and Distribution of Electric Power Act, 1997, the Authority hereby modifies the Distribution Licence granted to **IBRAHIM FIBRES LIMITED** (issued on July 22, 2008 and expiring on December 30, 2021), to the extent of changes mentioned as here under: -


- (a). Changes in Schedule-I attached as Revised/Modified Schedule-I; and
- (b). Changes in Schedule-II attached as Revised Schedule-II.

This **Modification-I** is given under my hand this 03<sup>rd</sup> of **September**  
**Two Thousand & Thirteen**



Registrar








**SCHEDULE-I**  
**Revised/Modified**  
**Modification-I**

The details of the distribution facilities, including detail of the consumers, length of feeders and other specific pertaining to the Distribution Network of the Licensee are described in this Schedule.

*[Handwritten signature]*



*[Handwritten signature]*

*[Handwritten signature]*

*[Handwritten signature]*

**Detail of  
Distribution Facilities of  
the Licensee**


**(A). General Information**

|        |                             |  |
|--------|-----------------------------|--|
| (i).   | Name of Applicant           | Ibrahim Fibres Limited                                   |
| (ii).  | Registered /Business Office | 1-A, Ahmed Block, New Garden Town<br>Lahore, Punjab.     |
| (iii). | Plant Location              | 38-Km Faisalabad-Sheikhupura Road,<br>Faisalabad, Punjab |

**(B). Distribution Network System Details**

|      |                            |                              |                       |
|------|----------------------------|------------------------------|-----------------------|
| (i). | No. of Feeders             | 18                           |                       |
| (ii) | Length of Each Feeder (KM) | Feeder Number                | Length of Feeder (KM) |
|      |                            | F-1 (XLPE Underground Cable) | 1.6                   |
|      |                            | F-2 (XLPE Underground Cable) | 1.6                   |
|      |                            | F-3 (XLPE Underground Cable) | 1.6                   |
|      |                            | F-4 (XLPE Underground Cable) | 1.6                   |
|      |                            | F-5 (XLPE Underground Cable) | 1.6                   |
|      |                            | F-6 (XLPE Underground Cable) | 1.6                   |
|      |                            | F-7 (XLPE Underground Cable) | 1.6                   |
|      |                            | F-8 (XLPE Underground Cable) | 1.6                   |
|      |                            | F-9                          | 1.6                   |
|      |                            | F-10                         | 1.6                   |
|      |                            | F-11                         | 1.6                   |
|      |                            | F-12                         | 1.6                   |
| F-13 | 3.4                        |                              |                       |


*[Handwritten signature]*



*[Handwritten signature]*

|       |  |   |                              |                       |
|-------|--|---|------------------------------|-----------------------|
|       |  | F-14  | 3.4                          |                       |
|       |  | F-15  | 3.4                          |                       |
|       |  | F-16  | 3.4                          |                       |
|       |  | F-17  | 3.4                          |                       |
|       |  | F-18  | 3.4                          |                       |
| (iii) | Length of Each Feeder to Each Consumer | Consumer  | Feeder Number                | Length of Feeder (KM) |
|       |  | Ibrahim Fibers Limited/IFL (Polyester Plant-PP)   | F-1 (XLPE Underground Cable) | 1.6                   |
|       |  |   | F-2 (XLPE Underground Cable) | 1.6                   |
|       |  |   | F-3 (XLPE Underground Cable) | 1.6                   |
|       |  |   | F-4 (XLPE Underground Cable) | 1.6                   |
|       |  |   | F-5 (XLPE Underground Cable) | 1.6                   |
|       |  |   | F-6 (XLPE Underground Cable) | 1.6                   |
|       |  |   | F-7 (XLPE Underground Cable) | 1.6                   |
|       |  |   | F-8 (XLPE Underground Cable) | 1.6                   |
|       |  |   | F-9                          | 1.6                   |
|       |  |   | F-10                         | 1.6                   |
|       |  |   | F-11                         | 1.6                   |
|       |  |   | F-12                         | 1.6                   |
|       |  | Ibrahim Fibers Limited/IFL (Textile Plant-1/TP-1) | F-13                         | 3.4                   |
|       |  |   | F-14                         | 3.4                   |
|       |  |   | F-18                         | 3.4                   |
|       |  | Ibrahim Fibers Limited/IFL (Textile Plant-2/TP-2) | F-15                         | 3.4                   |
|       |  |   | F-16                         | 3.4                   |
| F-17  | 3.4                                    |   |                              |                       |

*[Handwritten mark]*




*[Handwritten signature]*

**(C). Distribution Network System Details**

| (i).   | No. of Consumers   | 03   |                              |                       |
|--|--|--|------------------------------|-----------------------|
| (ii).  | Location of Consumers (Distance and/or Identity of Premises/Length of Each Feeder) | Consumer & Location  | Feeder Number                | Length of Feeder (KM) |
|  |  | Ibrahim Fibres Limited/IFL (Polyester Plant-PP)/38-KM Faisalabad-Sheikhupura Road    | F-1 (XLPE Underground Cable) | 1.6                   |
|  |  |  | F-2 (XLPE Underground Cable) | 1.6                   |
|  |  |  | F-3 (XLPE Underground Cable) | 1.6                   |
|  |  |  | F-4 (XLPE Underground Cable) | 1.6                   |
|  |  |  | F-5 (XLPE Underground Cable) | 1.6                   |
|  |  |  | F-6 (XLPE Underground Cable) | 1.6                   |
|  |  |  | F-7 (XLPE Underground Cable) | 1.6                   |
|  |  |  | F-8 (XLPE Underground Cable) | 1.6                   |
|  |  |  | F-9                          | 1.6                   |
|  |  |  | F-10                         | 1.6                   |
|  |  | F-11   | 1.6                          |                       |
|  |  | F-12   | 1.6                          |                       |
|  |  | Ibrahim Fibres Limited/IFL (Textile Plant-1/TP-1)/ 40-KM Faisalabad-Sheikhupura Road | F-13                         | 3.4                   |
|  |  | F-14   | 3.4                          |                       |
| F-18   | 3.4  |  |                              |                       |
| Ibrahim Fibres Limited/IFL (Textile Plant-2/TP-2)/ 40-KM Faisalabad-Sheikhupura Road | F-15   | 3.4  |                              |                       |
| F-16   | 3.4  |  |                              |                       |
| F-17   | 3.4  |  |                              |                       |

*[Handwritten mark]*

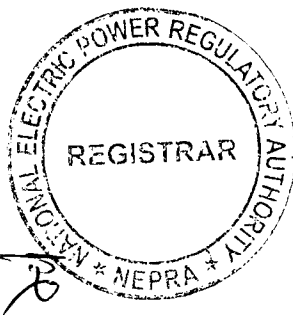


*[Handwritten signature]*  
Page 4 of 6 of Schedule -I

(D). Other Information


|      |                             |   |                    |
|------|-----------------------------|---|--------------------|
|      |                             | Voltage Level                                     | 11 KV              |
| (i)  | Generation Voltage          | Frequency   | 50 Hz $\pm$ 0.5 Hz |
| (ii) | Type of Distribution System | Overhead Feeders + Underground XLPE Cable Feeders |                    |

*[A large diagonal line is drawn across the page, likely indicating a signature or a mark.]*

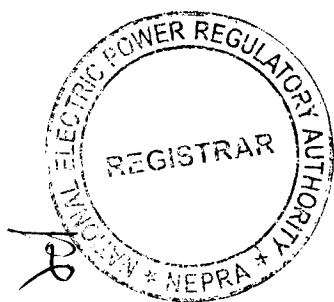

*[Handwritten signature or initials.]*

## IBRAHIM FIBRES LIMITED POWER GENERATION-1 11 KV DISTRIBUTION NETWORK

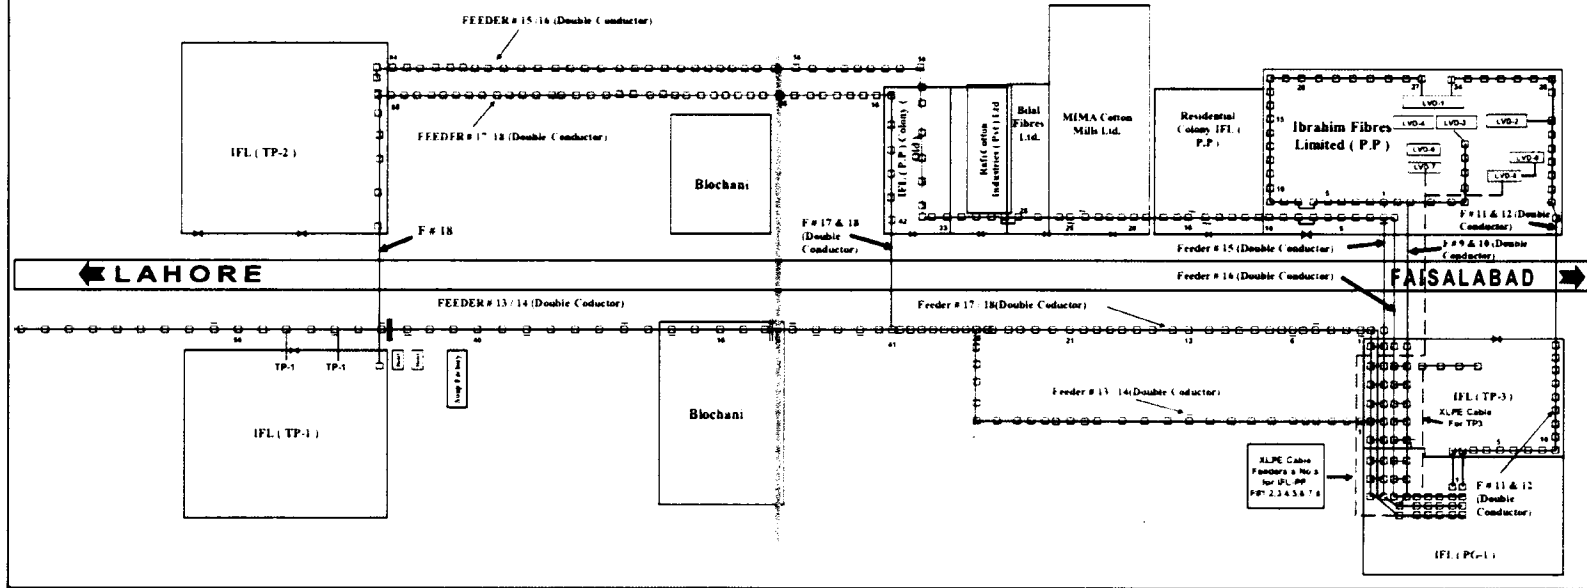

Fm

/






**SCHEDULE-II**  
**Revised/Modified**  
**Modification-I**

List of Dedicated Consumers in respect of which Second Tier Supply Authorization/Generation Licence has been Granted to Ibrahim Fibres Limited (IFL) as Small Power Producer (SPP) and are still being provided Sale/Service by IFL as per Available Information is given in this Schedule

24

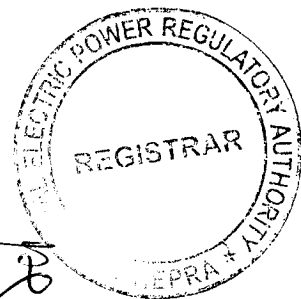


*[Handwritten signature]*

**List of Dedicated Consumers in respect of Which Second Tier Supply Authorization/Generation Licenece has been Granted to Ibrahim Fibers Limited (IFL) as Small Power Prodcuer (SPP) and are still being Provided Sales/Service by IFL as Per Available Information**

|      |   |
|------|---|
| (1). | Ibrahim Fibers Limited/IFL (Polyester Plant-PP)/38-KM Faisalabad-Sheikupura Road    |
| (2). | Ibrahim Fibers Limited/IFL (Textile Plant-1/TP-1)/ 40-KM Faisalabad-Sheikupura Road |
| (3). | Ibrahim Fibers Limited/IFL (Textile Plant-2/TP-2)/ 40-KM Faisalabad-Sheikupura Road |

*[Handwritten signature]*

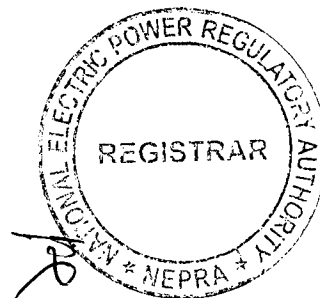

**National Electric Power Regulatory Authority**  
**(NEPRA)**

**Determination of Authority**  
**in the Matter of Licensee Proposed Modification (LPM) of**  
**Ibrahim Fibres Limited for its Distribution Licence**

**August 28, 2013**  
**Application No. LAD-30**

**(A). Background**


(i). Ibrahim Fibres Limited (IFL) is a Small Power Producer (SPP) having its Generation and Distribution facilities, located at 38-Kilometer Faisalabad-Shiekhupura, which is part of its Polyester Plant.

(ii). The Authority has granted two different Licences to Ibrahim Fibres Limited for the above facilities. This includes a Generation Licence (No. SGC/33/2007, dated October 10, 2007) and a Distribution Licence (No.17/DL/2008, dated July 22, 2008).

**(B). Communication of LPM**

(i). In terms of Regulation 10 of the of NEPRA Licensing (Application & Modification Procedure) Regulations, 1999 (the Regulations), IFL communicated an LPM on December 17, 2012. IFL in the "Text of the proposed Modification" stated that at present our Installed Generation Capacity is 31.80 MW [consisting of 6 x 5.80 MW Diesel Generating (D.G.) Sets operating on Residual Furnace Oil]. IFL plans to add another 26.50 MW (5 x 5.30 MW D.G.) for supplying to its new Polyester Plant. In order to transport the additional generation capacity, IFL would lay more underground XL-PE Cable measuring 12.80KM besides overhead feeders, increasing the total feeders crossing public roads from 8 to 18 within the allowed corridor of the Authority.

(ii). Regarding "Reason in Support of Modification" statements, IFL submitted that as IFL is installing a Polyester Staple Fiber Plant extension project at 38-KM Faisalabad-Sheikhupura Road. Being a sensitive chemical unit requiring uninterrupted power supply for its operation, IFL proposes connecting this new

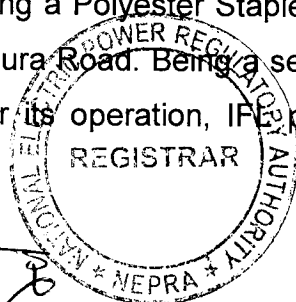

fiber plant to our generation facility through an underground cable which will increase our total number of feeders/underground cables as explained above.

(iii). Regarding the "Impact on Tariff", "Quality of Service (QoS)" and "Performance", IFL submitted that the proposed addition of feeder/underground cables for supplying/delivering to our own units of Ibrahim Fibers Limited and would not have any impact on tariff. The proposed addition in feeders would result in better quality of service for IFL as not only we will be able to serve the growing load of our units but it will result in more flexibility/redundancy of our plant operation. All these factors mentioned will definitely improve our performance as Licensee.

### **(C). Processing of LPM**

(i). After completion of all the required information as stipulated under the Regulation 10 (2) and 10 (3) of the Regulations by IFL, the Registrar published the communicated LPM on January 30, 2013 in one English and one Urdu daily newspapers, seeking comments of general public and other stakeholders.


(ii). Apart from the notice in the press, separate notices were also sent to experts, government ministries and representative organization etc. on January 30, 2013 inviting their views and comments in favor or against the communicated LPM.

### **(D). Comments of Stakeholders**

(i). In response to the above, NEPRA received comments from two (02) stakeholders. These included Ministry of Petroleum and Natural Resources (MoP&NR) and Ministry of Water and Power (MoW&P).

(ii). The salient points of the comments offered by the above mentioned stakeholder are summarized in the following paragraphs: -

- (a) MoP&NR commented that Import, sale and Pricing of Furnace Oil have been totally deregulated and therefore all Sale, Purchase Agreements/terms and conditions should be agreed

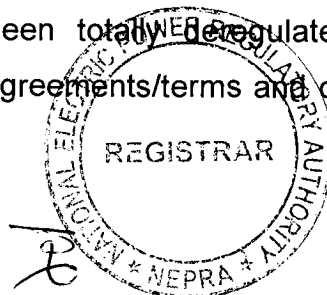

between buyer and seller. However, the product should conform to the approved specifications of GOP, which are already available with MoW&P.


(b) MoW&P submitted that the Ministry supports the application for modification in Distribution Licence. NEPRA may consider and decide as per prescribed procedures and formalities.

(iii). The Authority considered the comments of the stakeholders and did not find the same relevant to the communicated LPM. Accordingly, the Authority decided to proceed further in the matter in terms of the relevant Regulations and NEPRA Licensing (Distribution) Rules 1999 (the Rules) for the approval of the communicated LPM.

### **(E). Approval of LPM**

(i). The Authority is well aware that presently there is severe shortage of electricity in the country and there is huge Supply-Demand gap. In view of this, the Distribution Companies are facing difficulties in serving their consumers. Due to the prevailing situation, the Industrial Units are forced to make their own arrangements to meet their electricity requirements.


(ii). IFL is a chemical unit which has installed its own generation facility to meet its electricity requirements. Further, IFL is now expanding its Polyester Plant and to operate this, IFL will be requiring additional uninterrupted electricity. However, in view of the prevailing situation, it is not possible to arrange the same through the concerned Distribution Company (i.e. Faisalabad Electric Supply Company Limited/FESCO). In consideration of the above, the Authority has approved the request of IFL for addition of Generation Capacity by modifying its Generation Licence. In order to disperse the additional power, IFL requires laying of additional feeders. As explained at Para A(ii) above, IFL already holds a Distribution Licence for which the Authority has granted a corridor of 3-meters on either side of the Distribution Facilities of IFL. In this regard, IFL has confirmed that the additional feeders/underground cables would be lying in the same corridor without infringing the Service Territory of FESCO.

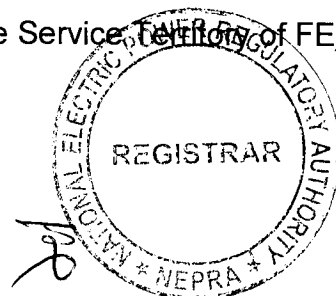


(iii). Accordingly, the already granted Distribution Licence (No. 17/DL/2008, dated July 22, 2008) in the name of IFL is hereby modified. The revised Face Sheet indicating the changes made to the Distribution Licence is attached as Annexure to this determination. The grant of LPM would be subject to the provisions contained in the NEPRA Act and relevant rules framed there under.

**Authority**


Habibullah Khilji  
Member

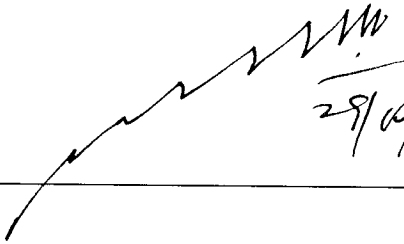
  
29/09/2013


Maj (Rtd) Haroon Rashid  
Member

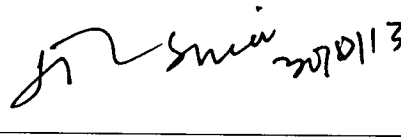
  
29/09/2013

Khawaja Muhammad Naeem  
Member/ Vice Chairman

  
02 9 2013

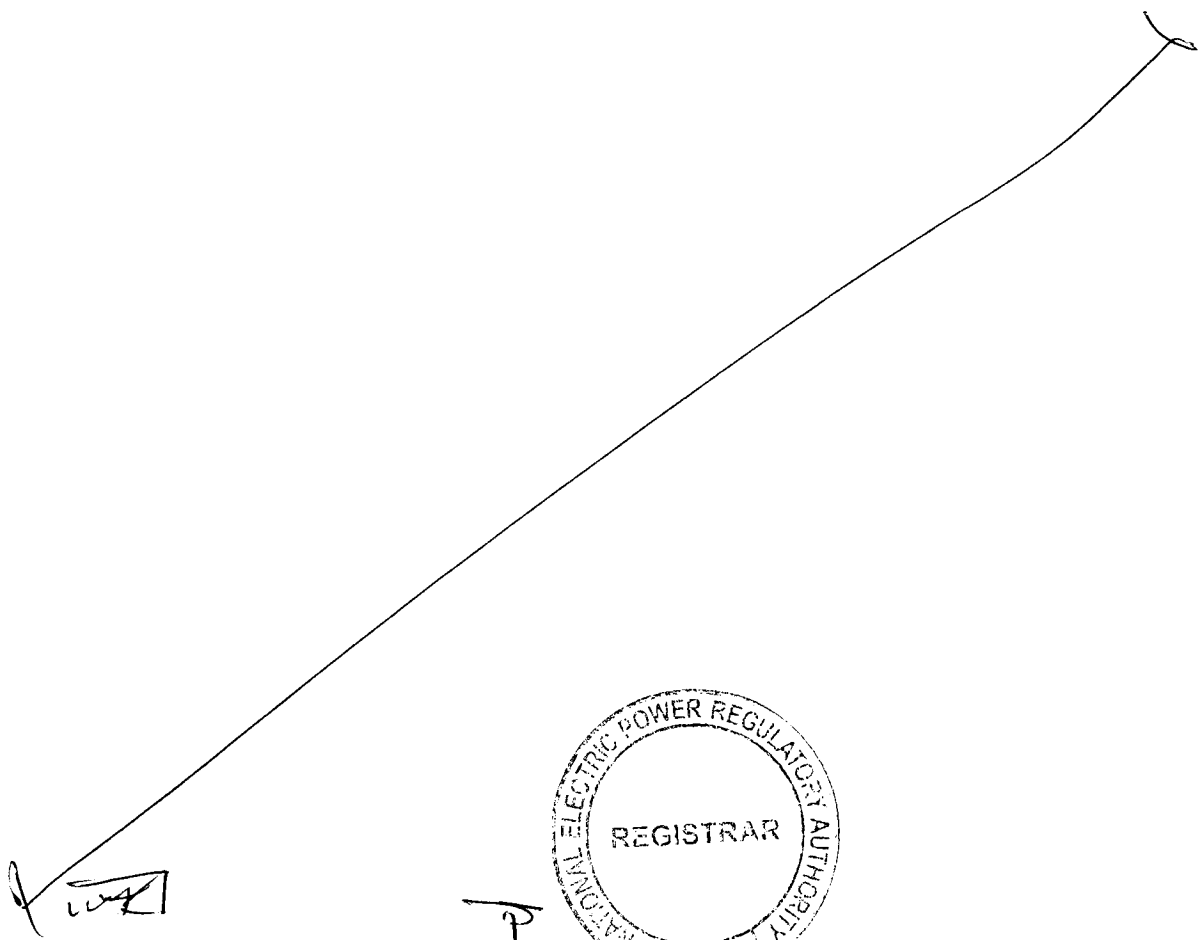



  
04.09.13